

1789. Wind-induced vibration control of power transmission tower using pounding tuned mass damper

Li Tian¹, Xia Gai²

School of Civil Engineering, Shandong University, Jinan, China

¹Corresponding author

E-mail: ¹tianli@sdu.edu.cn, ²gaixia0616@163.com

(Received 23 July 2015; received in revised form 14 September 2015; accepted 5 October 2015)

Abstract. Wind-induced vibration control of power transmission tower using pounding tuned mass damper is studied in the paper. The power transmission tower, which is often a high and flexible structure, is very susceptible to wind-induced vibrations. To reduce the wind-induced vibration of a transmission tower, a new type of vibration control device that pounding tuned mass damper (PTMD) is proposed in the PTMD, a limiting collar with viscoelastic material laced on the inner rim is installed to restrict the stroke of the tuned mass and to dissipate energy through collision. The pounding force is modeled based on the Hertz contact law. A 55 m tower is selected to verify the effectiveness of the PTMD. The wind field is generated based on Kaimal spectrum using harmonic superposition method. The power transmission towers without control and with the PTMD are analyzed, respectively. Results show that the PTMD is very effective in reducing the wind-induced vibration and the vibration control performance improves as the external wind load increases.

Keywords: power transmission tower, wind-induced vibration, structural control, pounding tuned mass damper.

1. Introduction

With the development of the national economy, the demand for electric power is growing dramatically. The high-voltage transmission tower is a vital component in the power transmission system. However, the transmission tower is often a high and flexible structure with low damping associated with the fundamental oscillation mode. This configuration makes it very vulnerable to wind-induced vibrations [1]. Recent investigations have reported several tower failures due to wind excitation [2, 3]. The wind induced collapse of transmission towers is shown in Fig. 1. Consequently, it is very important to reduce the wind-induced vibration of a transmission tower and thus improving its reliability.



Fig. 1. Wind induced collapse of transmission towers

To date, most retrofitting practices for transmission towers employ only static approaches such as increasing member section area or shortening effective member length by additional member [2]. These methods will tremendously increase the project cost and thus is not financially acceptable. An alternative approach is to install vibration control devices. The vibration control

devices designed for transmission towers can be divided into two categories. One category aims to enlarge the damping ratio by incorporating energy dissipating dampers such as friction-type reinforcing members [2], magneto rheological (MR) dampers [4], viscoelastic dampers (VED) [5], lead viscoelastic dampers (LVED) [6] and giant magnetostrictive material (GMM) actuators [7]. The other category aims to absorb the vibration energy from the primary transmission tower using attached dynamic absorbers. Kilroe [8] installed vibration absorbers on members of tower arms to mitigate the fatigue phenomena. Battista et al. [9] proposed a nonlinear pendulum-like damper (NLPD), and the nonlinear pendulum-like dampers installed on the towers were envisaged. Tian et al. [10] investigated the optimal parameter of TMD and the responses of transmission tower-line system with and without optimal TMD under wind excitations using SAP2000. The results show that, at any moment of wind response time history, the optimal TMD can effectively reduce wind vibration, which have great significance for real construction and practical engineering application. Zhang et al. [11] proposed to utilize the internal resonance feature of the SP in order to reduce the wind-induced vibration of the power transmission tower-line system. The results show that the spring pendulum absorbs more energy and reduces the oscillation more effectively than those of the suspended mass pendulum. In above studies, the NLPD, TMD and SP for transmission towers under wind excitation were carried out. Nevertheless, these dynamic absorbers often utilize a damping element to dissipate the absorbed energy. The damping element often demands continuous maintenance, which is unrealistic in practical project [12]. An alternative device is the impact damper. Its features, such as easy to install and maintenance free, make it very attractive for practical implementation [13]. To date, the pounding tuned mass damper (PTMD) for transmission towers under wind excitation has not been investigated.

In this paper, the PTMD is proposed to improve the wind-resistant performance of a transmission tower. The PTMD can be regarded as combination of the traditional TMD and the impact damper. It utilizes the tuned mass to absorb vibration energy and dissipates the absorbed energy through collisions. To examine the performance of the PTMD, a pounding force model is established based on the Hertz contact law. A 55 m tower is selected as the primary structure to be controlled. The wind field is generated based on Kaimal spectrum using harmonic superposition method. The power transmission towers without control and with the PTMD are analyzed, respectively.

2. Schematic of the PTMD

In concept, the PTMD can be regarded as a combination of a TMD and an impact damper. Fig. 1 compares the schematic of a TMD, an impact damper and the PTMD. As shown in Fig. 2(a), the TMD is an added mass (m_2) connected to the primary structure (m_1) by a spring and a damping element. It can absorb kinetic energy from the primary structure and dissipate the absorbed energy through the damping element. However, the control effectiveness is very sensitive to the damping ratio of these damping elements. It's troublesome to design, manufacture, install and maintain a damper of a specific damping ratio in practical project. An alternative vibration suppression device is the impact damper [12, 13]. Fig. 2(b) shows the schematic of an impact damper. It is a free moving mass restricted by boundaries mounted on the primary structure. The moving mass can collide on the boundaries, resulting in large amount energy dissipation and momentum exchanges. Previous studies [12] have shown that the impact damper is more effective than the TMD in mitigating the response of a lightly damped structure under dynamic loading. Fig. 2(c) shows the schematic of the PTMD. The PTMD is basically a tuned mass constrained by two boundaries. It has two vibration mitigation mechanisms: when the tuned mass vibrates between the two boundaries, it absorbs the kinetic energy as a TMD; when the mass impacts on either boundary, it dissipates the absorbed energy as an impact damper. Li and Darby [12] found that by introducing a flexible buffer zone between the moving damper mass and the boundaries can enhance the vibration control effect. Therefore, boundaries of the PTMD are covered with viscoelastic materials.

Fig. 3 illustrates the PTMD designed for vibration control of a transmission tower. A metal ball is hanged by a cable inside a pipe. The length of the cable is determined so as to match the natural frequency of the tower. The pipe's inner surface is covered with viscoelastic material. When the ball impacts it, the pipe can dissipate the kinetic energy and restrict the motion of the ball.

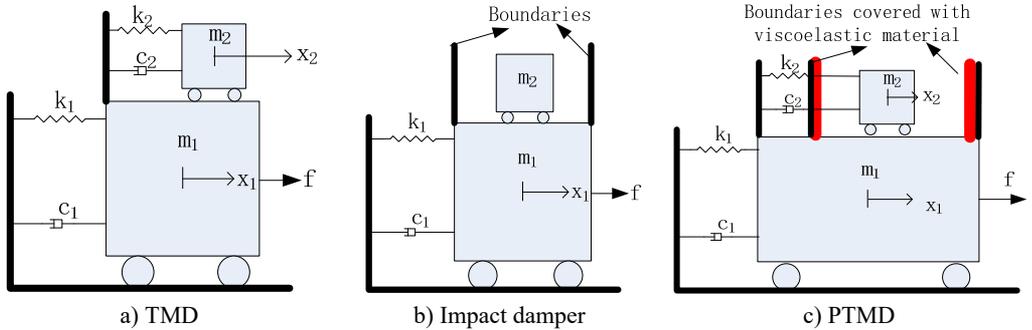


Fig. 2. Schematic of TMD, impact damper and PTMD

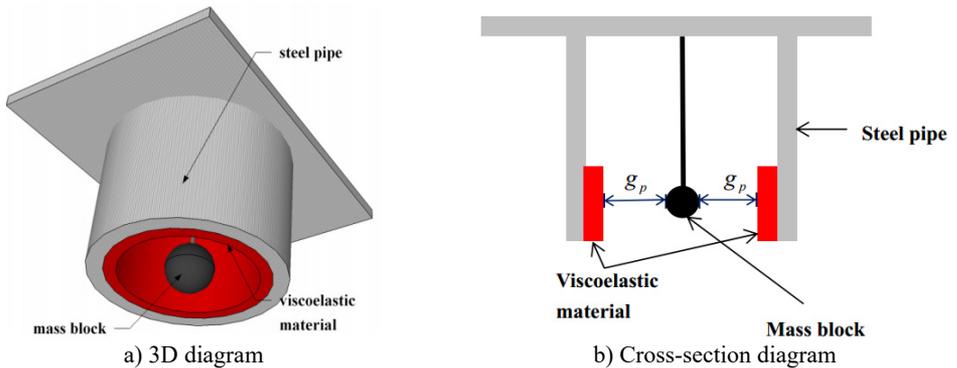


Fig. 3. PTMD designed for a transmission tower

3. Model of the pounding force

A numerical model is required to analyze the response of a structure controlled by a PTMD. During the past decade, several models have been proposed to study the impact of an adjacent building in severe earthquakes. Among them the nonlinear model based on the Hertz contact element in conjunction with a damper is most precise [14], and therefore is adopted in this paper. The pounding force is expressed as:

$$F = \begin{cases} \beta(x_1 - x_2 - g_p)^{\frac{3}{2}} + c(\dot{x}_1 - \dot{x}_2), & x_1 - x_2 - g_p > 0, \dot{x}_1 - \dot{x}_2 > 0, \\ \beta(x_1 - x_2 - g_p)^{\frac{3}{2}}, & x_1 - x_2 - g_p > 0, \dot{x}_1 - \dot{x}_2 < 0, \\ 0, & x_1 - x_2 - g_p < 0, \end{cases} \quad (1)$$

where x_1 and x_2 are the displacements of the pounding motion limiting collar and the mass block, g_p is the gap between them. $x_1 - x_2 - g_p$ is the relative pounding deformation and $\dot{x}_1 - \dot{x}_2$ is the relative velocity. β is the pounding stiffness coefficient that mainly depends on material properties and the geometry of colliding bodies. Since the viscoelastic material is highly nonlinear, the impact damping c is not constant. It depends on the pounding stiffness and the deformation of the viscoelastic layer. At any instant of time its value can be obtained from Eq. (2):

$$c = 2\xi \sqrt{\beta \sqrt{x_1 - x_2 - g_p} \frac{m_1 m_2}{m_1 + m_2}}, \tag{2}$$

$$\xi = \frac{9\sqrt{5}}{2} \frac{1 - e^2}{e(e(9\pi - 16) + 16)}, \tag{3}$$

where m_1 and m_2 are the masses of the two colliding bodies, and ξ is the impact damping ratio correlated with the coefficient of restitution e , which is defined as the relation between the post-impact (final) relative velocity, $\dot{x}_1^f - \dot{x}_2^f$, and the prior-impact (initial) relative velocity, $\dot{x}_1^0 - \dot{x}_2^0$, of the two colliding bodies:

$$e = \frac{|\dot{x}_1^f - \dot{x}_2^f|}{\dot{x}_1^0 - \dot{x}_2^0}. \tag{4}$$

The coefficient's values can be easily determined experimentally by dropping a sphere on a massive plane plate and observing the rebound height:

$$e = \sqrt{\frac{h^f}{h^0}}, \tag{5}$$

where h^0 and h^f are the initial height and rebound height, respectively.

After assessing the value of ξ , the pounding stiffness β can be determined numerically through iterative simulations, which tend to fit the experimentally obtained pounding force time histories. Zhang et al. [15] performed an experiment and estimated that $e = 0.2$ and $\beta = 17259 \text{ N/m}^{3/2}$.

4. Model of the transmission tower-PTMD system

4.1. Model of the power transmission tower

A practical transmission tower-line system illustrated in Fig. 4 is chosen as the primary structure to be controlled to investigate the vibration control performance of the proposed PTMD. The transmission tower is constructed of Q345 angle steels. Its height is 53.9 m. The nonlinear pounding force model currently cannot be implemented into any commercial finite element method. Consequently, the transmission tower is represented by a simplified multi-mass model as shown in Fig. 5.



Fig. 4. SZ21-type tangent transmission tower in Liaoning province, China

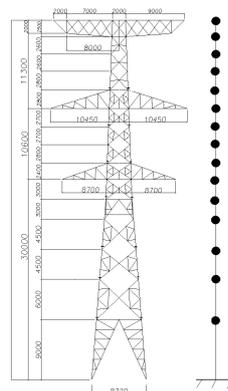


Fig. 5. Simplified model of the transmission tower (mm)

4.2. Model of the tower-PTMD system

Equation of motion of the tower-PTMD system can be expressed as:

$$\mathbf{M}\ddot{\mathbf{x}}(t) + \mathbf{C}\dot{\mathbf{x}}(t) + \mathbf{K}\mathbf{x}(t) = -\mathbf{M}\Lambda x_g(t) + H\Gamma F(t), \tag{6}$$

where $\ddot{\mathbf{x}}(t)$, $\dot{\mathbf{x}}(t)$ and $\mathbf{x}(t)$ are the acceleration, velocity and displacement of the tower and pounding TMD, $\ddot{x}_g(t)$ denotes the ground acceleration and $F(t)$ implies the pounding force calculated by Eq. (1). \mathbf{M} , \mathbf{C} and \mathbf{K} are the mass, damping and stiffness matrices, respectively:

$$\mathbf{M} = \begin{bmatrix} \mathbf{M}_s & 0 \\ 0 & m_d \end{bmatrix}, \quad \mathbf{C} = \begin{bmatrix} \mathbf{C}_s & \mathbf{C}_c \\ \mathbf{C}_c^T & c_d \end{bmatrix}, \quad \mathbf{K} = \begin{bmatrix} \mathbf{K}_s & \mathbf{K}_c \\ \mathbf{K}_c^T & k_d \end{bmatrix}, \tag{7}$$

where \mathbf{M}_s , \mathbf{C}_s and \mathbf{K}_s are the mass, damping and stiffness matrices of the tower structure. m_d , c_d and k_d are the mass, damping and stiffness of the damper. \mathbf{C}_c and \mathbf{K}_c are coupling matrices of the damping matrix and stiffness matrix. The PTMD is added to node 15, so \mathbf{C}_c and \mathbf{K}_c are defined as:

$$\mathbf{C}_{c(15 \times 1)} = [0, \dots, 0, -C_d]^t, \tag{8}$$

$$\mathbf{K}_{c(15 \times 1)} = [0, \dots, 0, -K_d]^t. \tag{9}$$

In Eq. (6) Λ is a column vector of ones, Γ denotes the location of the pounding force and H is defined to determine the direction of pounding force:

$$H = \begin{cases} 1, & x_d - x_{15} - g_p > 0, \\ -1, & x_d - x_{15} - g_p < 0, \\ 0, & \text{otherwise,} \end{cases} \tag{10}$$

where x_d and x_{15} are the displacements of damper and top node of the tower, respectively, and g_p denotes the gap between the mass block and the viscoelastic material.

5. Simulation of the wind field

The wind excitations of transmission tower-line system are simulated by harmony superposition method. The target power spectrum is Kaimal fluctuating wind power spectrum [16]. In order to study the stability and influence of the wind load intensity on the vibration control performance of the PTMD, the mean wind velocity at the height of 10 meters above the ground V_{10} is selected as 20 m/s, 30 m/s and 40 m/s.

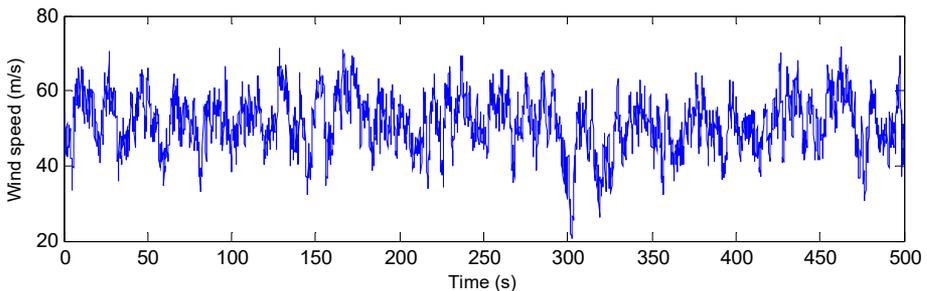


Fig. 6. Time history of wind speed at the top of the tower, $V_{10} = 40$ m/s

Because the transmission tower nodes are numerous, it is difficult to simulate the wind velocity history for every node of the tower. Consequently, the transmission tower is simplified by 15

regions as shown in Fig. 6. The fluctuating wind acts only on the center of each region. The position of each region center and windward area are listed in Table 1. Fig. 7 shows the wind speed on the top of the tower of the $V_{10} = 40$ m/s case. Fig. 7 compares the target wind power spectrum and the simulated time history of the fluctuating wind. As shown in the figure, the simulation results agree well with the target spectrum.

Table 1. The position of wind load and windward area

Region	Height of the region center (m)	Windward area (m ²)
1	9.00	7.083
2	15.0	4.507
3	19.5	1.868
4	24.0	2.435
5	26.8	2.369
6	30.0	2.344
7	32.4	2.029
8	35.2	1.672
9	37.9	1.602
10	40.6	1.810
11	43.4	1.591
12	46.2	1.117
13	48.8	1.062
14	51.4	1.164
15	53.9	0.611

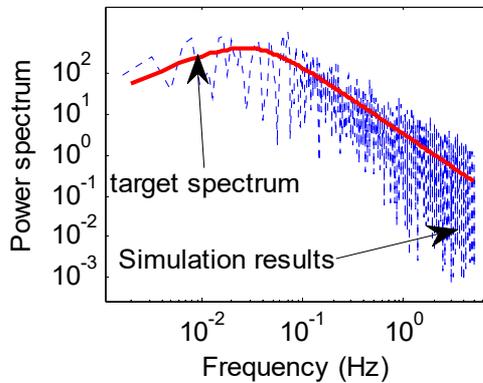


Fig. 7. Power spectral comparison between simulated and theoretical wind samples

6. Vibration control performance

In this section, a PTMD is designed to suppress the wind-induced vibration of the transmission tower. In order to evaluate the vibration control effectiveness of the proposed PTMD, the vibration reduction ratio is defined as:

$$\eta = \frac{R_0 - R_{ctrl}}{R_0} \times 100 \%, \tag{11}$$

where R_{ctrl} and R_0 are the responses of the tower with and without control devices. They can be the maximum value or the root mean square value (R.M.S.).

Figs. 8-10 show the results of the $V_{10} = 40$ m/s Case. Results of $V_{10} = 20$ m/s Case and $V_{10} = 30$ m/s Case are very similar to that of the $V_{10} = 40$ m/s Case. Therefore, the figures of those two cases are omitted in this paper. The vibration reduction ratios of those two cases can be found in Table 2.

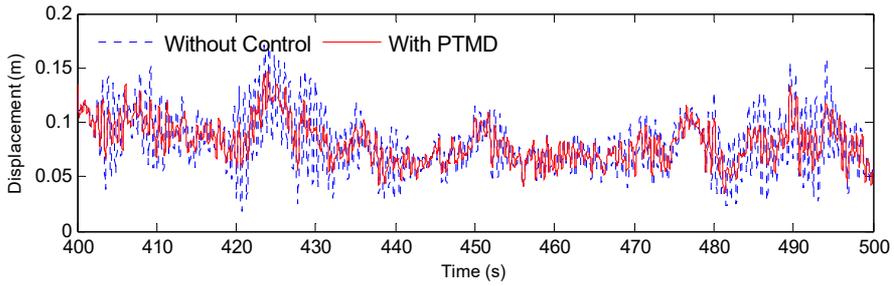


Fig. 8. Displacement time history at top of the tower 2, $V_{10} = 40$ m/s

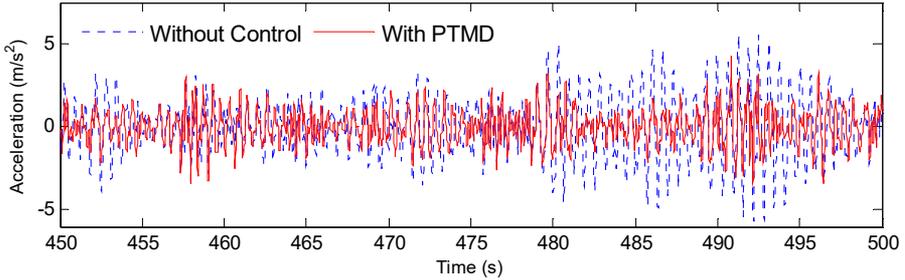


Fig. 9. Acceleration time history at top of the tower 2, $V_{10} = 40$ m/s

Fig. 8 and Fig. 9 compare the displacement and acceleration at the top of the tower from 400 s to 500 s in the $V_{10} = 40$ m/s Case. It is clear that the proposed PTMD is very effective in reducing the wind-induced vibration. The R.M.S. value of the displacement was reduced by 39.8 % and the acceleration by 35.3 %. Fig. 10 shows the envelopes of displacements, accelerations and internal forces of the transmission tower. The maximum displacement and acceleration was effectively reduced by the PTMD by 17.9 % and 24.6 %. The maximum axial force was also significantly mitigated with the reduction ratio to be 21.1 %.

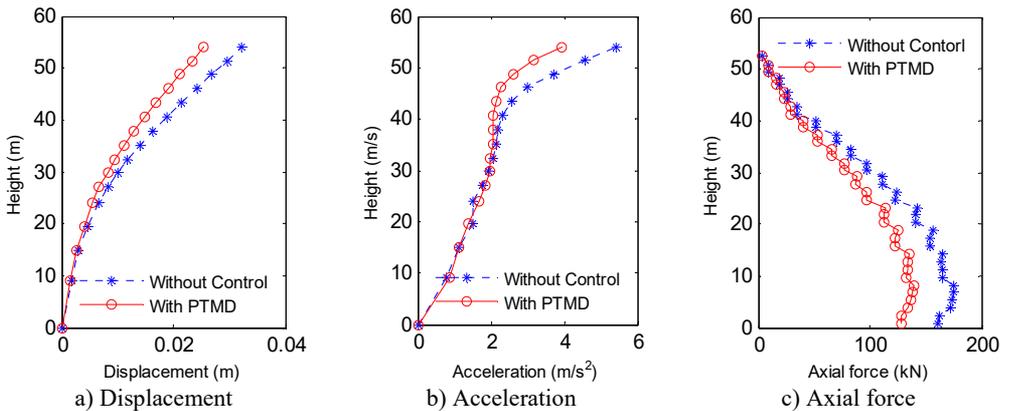


Fig. 10. Envelope of the response of the $V_{10} = 40$ m/s Case

The PTMD is a nonlinear damper in essential. Thus its vibration control performance may be influenced by the intensity of external loads. Table 2 lists the vibration reduction ratio of the PTMD under 3 cases, namely the $V_{10} = 20$ m/s case, the $V_{10} = 30$ m/s Case and the $V_{10} = 40$ m/s Case. It is clear from Table 2 that the vibration performance is influenced by the level of wind loads. As the wind speed increases, the vibration reduction ratio of the PTMD also increases, which implies that the PTMD is more effective under strong winds. The vibration reduction ratio of the maximum acceleration increases more significantly than those of maximum displacement

and maximum axial force with the wind speed increasing. The impact damper would play a greater role due to the larger level of wind loads.

Table 2. Comparison of the vibration reduction ratio of PTMD

Wind speed	RMS of Disp.	RMS of Acc.	Max Disp.	Max Acc.	Max axial force
$V_{10} = 20$ m/s	31.0 %	22.8 %	12.5 %	9.9 %	12.4 %
$V_{10} = 30$ m/s	36.2 %	30.1 %	14.3 %	16.4 %	16.9 %
$V_{10} = 40$ m/s	39.8 %	35.3 %	17.9 %	24.6 %	21.1 %

7. Conclusion

In this paper, the PTMD was proposed for the suppression of wind-induced vibration of the transmission tower. The viscoelastic material was adopted to dissipate the energy absorbed by the tuned mass through collision. The pounding force model was established based on the Hertz contact law. A practical transmission tower was established to assist numerical study. The transmission tower was simulated by a multi-mass model. The wind field is generated based on Kaimal spectrum using harmonic superposition method. Based on theoretical analysis and numerical simulation results, the following conclusions are drawn: (1) the PTMD is very effective in reducing the wind-induced vibration of a transmission tower; (2) as the intensity of the wind load increases, the vibration control performance of the PTMD also increases.

In this paper, parameters of the PTMD were not optimized. In further study, influence of these parameters on the vibration control performance should be investigated to achieve optimal design.

Acknowledgements

This research is supported by Ph.D. Programs Foundation of Ministry of Education of China Project under Grant No. 20120131120036 and Shandong Provincial Natural Science Foundation of China under No. ZR 2012EEQ005.


References

- [1] **Li C., Li J., Yu Z.** A review of wind-resistant design theories of transmission tower-line systems. *Journal of Vibration and Shock*, Vol. 28, 2009, p. 15-25, (in Chinese).
- [2] **Park J., Moon B., Min K., Lee S., Kim Kyeong C.** Cyclic loading test of friction-type reinforcing members upgrading wind-resistant performance of transmission towers. *Engineering Structures*, Vol. 29, 2007, p. 3185-3196.
- [3] **Xie Q., Zhang Y., Li J.** Investigation on tower collapses of 500 kV rensang 5237 transmission line caused by downburst. *Power System Technology*, 2006, p. 59-63+89, (in Chinese).
- [4] **Chen B., Zheng J., Qu W.** Control of wind-induced response of transmission tower-line system by using magnetorheological dampers. *International Journal of Structural Stability and Dynamics*, 2009, p. 661-685.
- [5] **Wang W., Zhao D., Zhong W., Xu J., Ling J., Xiao X.** Effect of wind-induced vibration's control for high-voltage transmission tower based on prototype measurement. *Journal of Central South University (Science and Technology)*, Vol. 44, 2013, p. 3911-3917, (in Chinese).
- [6] **Li L., Yin P.** The research on wind-induced vibration control for big-span electrical transmission tower-line system. *Engineering Mechanics*, Vol. 25, 2008, p. 213-229, (in Chinese).
- [7] **Wang S., Zhu X., Zhu J., Dai J., Zhao X.** Optimal placement of GMM actuators for active vibration control of a power transmission tower. *Journal of Vibration and Shock*, Vol. 31, 2012, p. 48-52, (in Chinese).
- [8] **Kilroe N.** Aerial method to mitigate vibration on transmission towers. *IEEE 9th International Conference on Transmission and Distribution Construction, Operation and Live-Line Maintenance Proceedings*, Montreal, Que, Can, 2000, p. 187-194.
- [9] **Battista R. C., Rodrigues R. S., Pfeil M. S.** Dynamic behavior and stability of transmission line towers under wind forces. *Journal of Wind Engineering and Industrial Aerodynamics*, Vol. 91, 2003, p. 1051-1067.

- [10] **Tian L., Wang Q., Yu Q., Xu N.** Wind-induced vibration optimal control for long span transmission tower-line system. *The Open Civil Engineering Journal*, Vol. 7, 2013, p. 159-163.
- [11] **Zhang P., Ren L., Li H. N., Jia Z. G., Jiang T.** Control of wind-induced vibration of transmission tower-line system by using a spring pendulum. *Mathematical Problems in Engineering*, 2015, p. 671632.
- [12] **Li K., Darby A. P.** An experimental investigation into the use of a buffered impact damper. *Journal of Sound and Vibration*, Vol. 291, 2006, p. 844-860.
- [13] **Li K., Darby A. P.** Experiments on the effect of an impact damper on a multiple-degree-of-freedom system. *Journal of Vibration and Control*, Vol. 12, 2006, p. 445-464.
- [14] **Jankowski R.** Non-linear viscoelastic modelling of earthquake-induced structural pounding. *Earthquake Engineering and Structural Dynamics*, Vol. 34, 2005, p. 595-611.
- [15] **Zhang P., Song G., Li H., Lin Y.** Seismic control of power transmission tower using pounding TMD. *Journal of Engineering Mechanics*, Vol. 139, 2013, p. 1395-1406.
- [16] **Kaimal J. C., Wyngaard J. C., Lzumi Y., Cote O. R.** Spectral characteristics of surface-layer turbulence. *Quarterly Journal of the Royal Meteorological Society*, Vol. 98, 1972, p. 563-589.



Li Tian received Ph.D. degree in School of Civil Engineering from Dalian University of Technology, Dalian, China, in 2011. Now Associate Professor Tian works at School of Civil Engineering in Shandong University. His current research interests include the seismic behavior and wind-resistant behavior of transmission tower-line system, structural vibration control, etc.



Xia Gai received Bachelor's degree in School of Civil Engineering from Shandong University, Jinan, China, in 2014. Now she studies at School of Civil Engineering in Shandong University specializing in structural engineering. Her current research interests include the simulation of multi-support and multi-dimensional ground motions, collapse analysis of transmission tower-line system, etc.